USER'S MANUAL
525VA/625VA

192321932012001

03/2012

IMPORTANT SAFETY INSTRUCTIONS

SAVE THESE INSTRUCTIONS

This manual contains important safety instructions. Please follow all instructions carefully during installation. Read this manual thoroughly before attempting to unpack, install or operate.

CAUTION- To prevent the risk of fire or electric shock, install in a temperature and humidity controlled indoor area, free of conductive contaminants.

CAUTION- Risk of electric shock, do not remove the cover. No user serviceable parts. Refer servicing to qualified service personnel.

CAUTION- Risk of electric shock, hazardous live parts inside this UPS can be energized from the battery supply even when the input AC power is disconnected.

CAUTION- Risk of electric shock, Battery Circuit is not isolated from AC input, hazardous voltage may exist between battery terminals and ground. Test before touching.

NOTICE- The UPS is designed to be for use with computer loads only.

CAUTION- This UPS meets Category C2. If used in living area it can cause interference with radio equipment. Then you need to make additional provisions.

SETUP

1 Inspection

Inspect the UPS upon receipt. Notify the carrier and dealer if there is damage. The package is recyclable; save it for reuse or dispose of it properly.

2 Placement

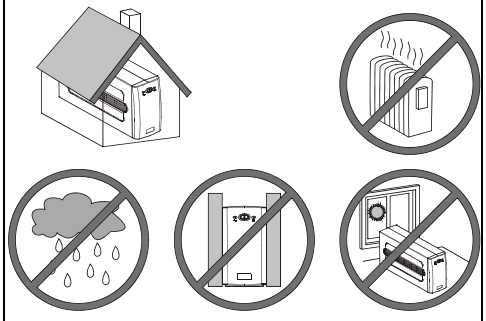

3 Check the Site Wiring Fault Indicator(115V only)

Caution: If the site wiring fault indicator lights, get a qualified electrician to correct the building wiring.

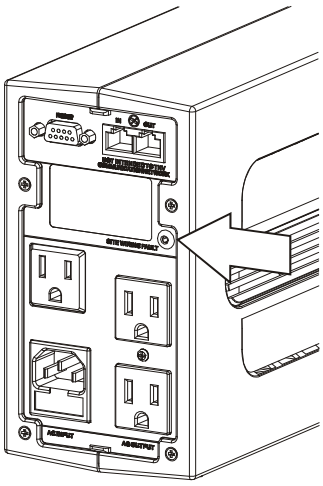

4 Connect the loads

First, connect the UPS with the AC Mains, then plug the loads into the output connectors on the rear of the UPS. To use the UPS as a master "On/Off" switch, make sure that all of the loads are switch "On".

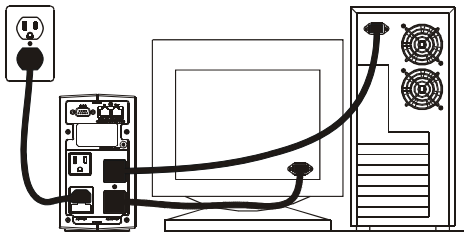

Caution: Do not connect a laser printer to the outlets. These UPS outlets provide battery power and surge protection to the equipment when utility voltage is outside acceptable limits.

5 Connect telephone / Network Surge protection

Connect a single line telephone or a 10 base-T / 100 base-T network cable into the RJ-45 / RJ-11 telephone / network surge protection "IN" jack on the back of the UPS. Connect from the "OUT" jack with telephone cable (supplied) or network cabling (not supplied) to a fax modem or network port.

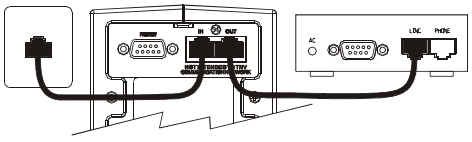

6 Connect Computer Interface Port(Optional)

Connect the supplied interface cable to the 9-pin computer interface port on the back of the UPS. Connect to the computer. See software document for installation instruction.

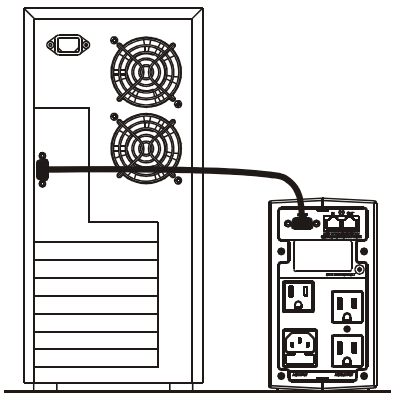

7 Operation Test

1. Connect the UPS to the wall receptacle.
2. Push on the Main Switch to check the Green Line (⏦) LED is on.
3. Connect your computer equipment with sockets of the UPS and pull off the input power cable of the UPS from the wall receptacle to check if the Line (⏦) LED is flashing every 3 seconds. Meanwhile, please check if alarm buzzer is beeping.
4. Try the field working condition by running some application programs on your computer and repeating step.
5. Check if the UPS is initiated properly to support continuous operation.
6. **IMPORTANT NOTICE:** Plug the UPS into the wall outlet to charge the UPS for over 8 hours before using the UPS.
7. **STORAGE:**
   Store at -15 to +30 ˚C (+5 to +86 ˚F), charge the UPS battery every six months.
   Store at +30 to +45 ˚C (+86 to +113 ˚F), charge the UPS battery every three months.

FRONT PANEL EXPLANATIONS

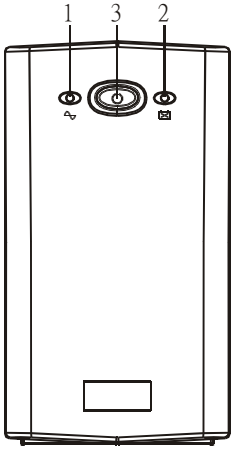

1. Line LED ( ):
   Green LED remains standstill when Utility is normal.
   Green LED flashes every 3 seconds and simultaneously buzzer alarms continuously when Utility failure.
   Green LED flashes every 3 seconds when the UPS is in Battery charging mode.
   Green LED remains standstill and simultaneously buzzer alarms continuously when the UPS is in overload condition.
2. Check Battery LED ( ):
   Red LED flashes every 0.5 seconds and buzzer alarms every 0.5 seconds when UPS is in battery low condition.
3. Main Switch:
   a. To Control on/off the UPS when Utility is normal.
   b. To enable “DC-Start” Function when Utility fails. (To enable DC Start properly, you are recommended to connect <80% output load with the UPS only)

P.S. Make sure the computer connected to the UPS is switched on before enable the "DC-Start" function. You are not recommended to add some other computer or peripherals after DC-Start function is activated.

REAR PANEL EXPLANATIONS

1. AC Inlet
2. Backup Outlets: 3pcs NEMA5-15R or IEC320
3. Computer Interface: True RS232 communication port.
4. RJ11/RJ45 Jacks: MODEM /LAN Protection
5. Site Wiring Fault Indicator: For 115Vac system only.
6. AC Fuse Holder. (W/fuse)
   525VA/115Vac/6A 800VA/115Vac/8A
   525VA/230Vac/4A 800VA/230Vac/6.5A
   625VA/115Vac/8A
   625VA/230Vac/6.5A

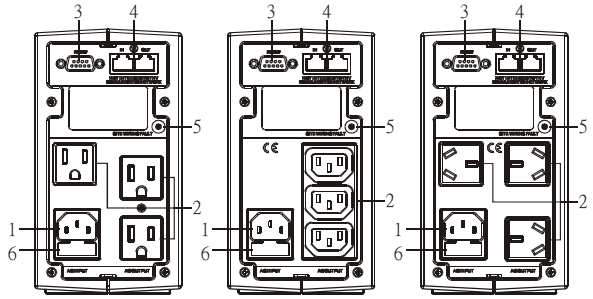

REPLACING THE BATTERY

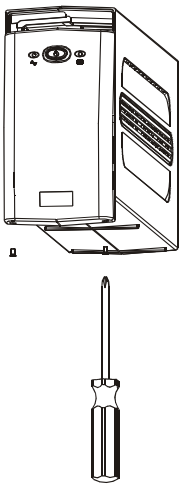

Note: Once the battery is disconnected, the loads are not protected from power outages.

1. Use a cross-type screwdriver to remove the two front panel screws and slide down the panel.
2. Gently Pull the battery out of the UPS.
3. Loosen the black wire from the negative (-) terminal and red wire from the positive (+) terminal.
4. Connect the battery leads to the new battery.
5. Note: Small sparks at the battery connectors are normal during connection.
6. Slide the battery into the UPS.
7. Close the front panel and fasten two screws.
8. Dispose of the old battery properly at an appropriate recycling facility.

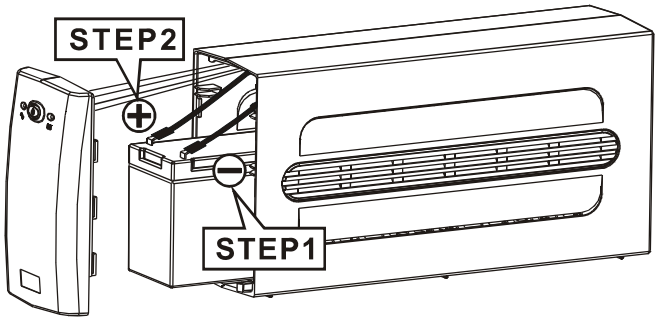

TROUBLE SHOOTING

When your UPS malfunctions during operation, you may check the list below for proper adjustment. If the adjustment still be in vain, please contact your sales agent for help.

Situation	Check Items	Solution
Mains normal but 'Line' LED is not on.	1. Is the power switch on? 2. Is the fuse in order? 3. Is the power cord loose?	1. .Press Main Switch on. 2. Change fuse w/same rating. 3. Re-connect the power cord properly.
'Line' LED flashes every second but no output	Battery voltage is too low	Recharge the UPS for 24 hours.
Alarm buzzer beeps continuously when Utility is normal.	Check to see load status if it is in overload.	Remove some uncritical load.
Alarm buzzer beeps for 10 seconds, then the UPS is turned off		Remove some uncritical load and re-switch on the UPS.
No LEDs display on the front panel		Consult with your sales agent For help.
UPS dose not provide expected back up time.	1. The UPS’s battery is weak due to recent outage. 2. The UPS’s battery is near the end of its service life.	1. Charge the battery. 2. If the battery is near the end of its service lift, consider replacing the battery.
The UPS operates normally, but the site wiring fault indicator is lit.	Building wiring error such as missing ground or hot to neutral wire reversal.	Have a qualified electrician correct the building wiring.